



Single Family Residential Fire / Flood Restoration Guide

Requirements for Permit Submittal:

1. An asbestos report will be required by the state of Colorado before the permit can be issued
2. The damaged portion of the building will be allowed to be restored **as it was**. Follow chapter 4 of the 2021 IEBC.

ANY PROPOSED CHANGES TO THE EXISTING FLOOR PLAN WILL REQUIRE A SEPARATE PERMIT.

All new installation of equipment or changes to the existing structure, will be required to be brought up to 2021 I-code and 2023 NEC.

These may include, but not limited to:

- a. Electrical Systems
- b. Mechanical systems (equipment, ducting, exhaust and venting)
- c. Plumbing systems / gas piping installation
- d. Attic insulation (if applicable)
- e. Fire rated assemblies

3. The customer can submit an open records request for plans on file. If none are found, basic architectural floor plans with dimensions, showing the existing layout, where the work area is, and any proposed changes to the building as it is.
4. Any changes to fire sprinkler or fire alarm systems are required to be submitted for review to LFRA.
5. An registered engineer is **required** to submit stamped letter for structure damage assessment before permit can be issued.
 - a. Letter required to contain observations and repairs
 - b. Engineered Drawings may be required to show repairs / replacement
 - c. All structural repairs must be brought up to the current code cycle
6. Items of the damaged part of the building can be restored to original condition
 - a. wall insulation
 - b. Egress windows (even if they are being replaced with the same size)
 - d. Mechanical and plumbing equipment that is in good working order and approved by the Building Official
 - e. Reuse of fixtures that are approved by the Building Official
7. An Electrical Service Worksheet is required. please fill out the form and submit to Loveland Power. Attach the signed / approved form with all other documents and this application.

Single Family Residential Fire / Flood Restoration Guide


Required Documents for Permit Submittal:

1. Fill out Building Permit Application

The City of Loveland processes all permit submittals electronically. Submittals can be emailed in to eplan-res@cityofloveland.org. Once a full submittal is received and accepted through the check in process, the review time is 3 business days.

The documents submitted help determine if the project is compliant with the International Residential Code, City of Loveland Municipal Codes, zoning ordinances, and other applicable laws.

2. Provide 1 floor plan, electronic or on 8.5 x 11in paper (example below)

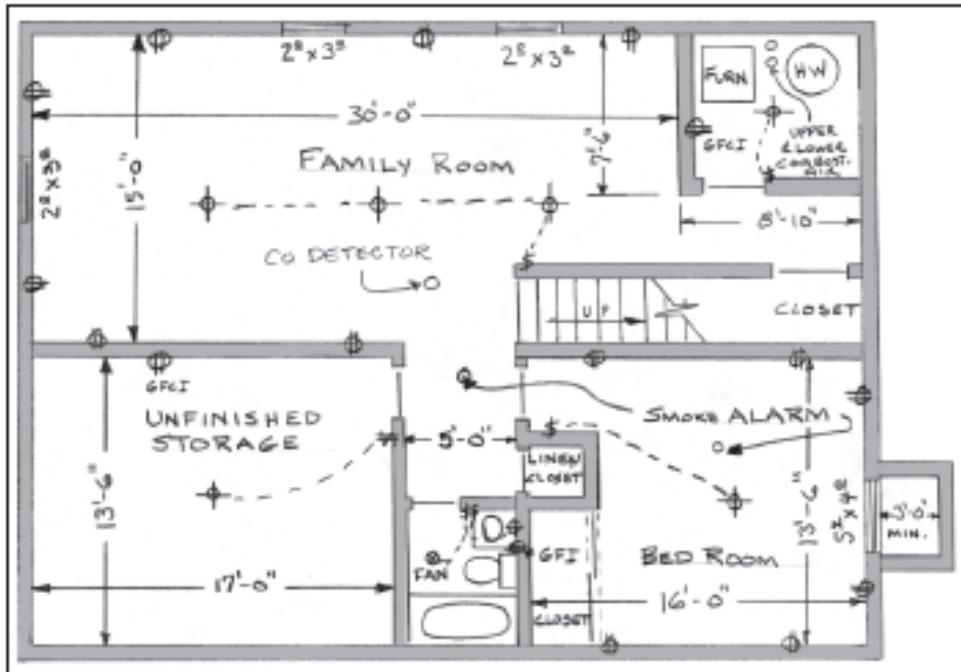

Using graph paper with $\frac{1}{4}$ inch squares can be helpful when drawing floorplans, as they must be drawn to scale.

The floor plan must include (if applicable to your project):

1. Dimensions of each room, showing the layout of the **entire** space to be altered. Label the use of each room.
2. Location of electrical outlets, smoke detectors, carbon monoxide detectors, lighting, fans, plumbing modifications, cleanouts, furnace, and water heater.
3. List window sizes and types, identify emergency escape and rescue windows, and egress window wells with ladder and clear dimensions of window well.
4. If modifications will be made to the existing structure, such as posts, beams, or floor joists, identify these modifications.
5. Show plumbing fixtures and clearances around each.
6. Specify insulation values.

General IRC Requirements

1. Ceiling Heights:

Minimum height of 7' as measured from the finished floor to the ceiling – if less, consult with Building Division. Beams, pipes, and ducts may project from the ceiling not less than 6'-4" from the finished floor.


2. Emergency Escapes:

Basements, habitable attics, and every sleeping room must have either an emergency escape window or exterior door. Emergency escape windows with a sill height below grade must be provided with an emergency escape window well and ladder, must open directly to the exterior, and must be operable from the inside without the use of special tools. See example for dimensional requirements.


Emergency Escape And Rescue Windows must meet the following criteria:

- A minimum total openable area of not less than 5.7 square feet
- A minimum clear openable height of not less than 24 inches
- A minimum clear openable width of not less than 20 inches.
- A finished sill height of not more than 44 inches above the floor and the window should be openable from the inside with normal operation and without the use of tools, keys or special knowledge.

Examples of Complying Height & Width Combinations

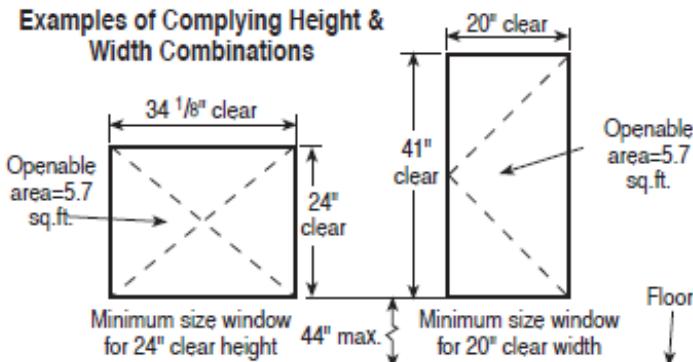

Emergency Escape And Rescue window wells must provide a minimum area of 9 square feet with a minimum dimension of 36 inches and shall enable the window to open fully. If the depth of the window well exceeds 44 inches, a permanently affixed ladder must be provided. The ladder must not interfere with the operation of the window.

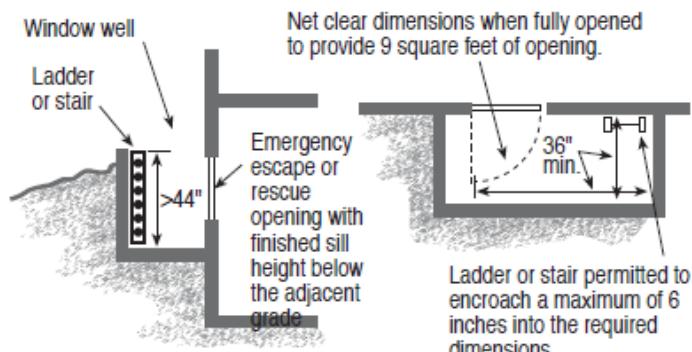

3. Smoke Detectors:

Smoke alarms shall be installed in each sleeping room, outside each separate sleeping area in the immediate vicinity of the bedrooms, and on each additional story of the dwelling, including basement and habitable attics but not including crawl spaces and uninhabitable attics. Smoke detectors added to satisfy the above requirements must be hard-wired with battery backup and interconnected with existing smoke detectors. Smoke detectors are required to be hardwired and interconnected in new and existing bedrooms, halls, and on each level unless removal of interior wall or ceiling finishes would be required. In those cases, battery operated devices are acceptable. Listed wireless detectors are acceptable.

4. Carbon Monoxide Detectors:

Carbon monoxide detectors are required on each floor with bedrooms. It is required that the detectors not be located further than 15 ft. from any bedroom entrance and must not be installed within 15 ft. of fuel burning appliances. Follow manufacturer's recommendations for location testing and replacement.

5. Fuel Burning Appliances:

Furnaces and hot water heaters cannot be located within or open into a bedroom or bathroom unless appliances are installed in a dedicated enclosing in which all combustion air is taken directly from outdoors, and a weather stripped solid door equipped with an approved self closing device is installed (see G2406 for other acceptable options). If the furnace and water heater are being enclosed, adequate combustion air must be provided to ensure the equipment functions properly. For maintenance purposes, a minimum of 30 inches clear working space must be provided in front

5. (Cont.) of furnaces and water heaters. Maintenance or removal of each appliance must be possible without removing the other or disturbing walls, piping, valves, ducts, vents, wiring, or junction boxes.


6. Floated Walls:

In areas subject to floor heaving, non-bearing walls on basement floor slabs should be built to accommodate not less than 1-1/2 inches of floor movement. A detail of a typical floated wall is included in this handout.

7. Fireblocking:

Fireblocking must be installed in concealed spaces of wood-furred walls at the ceiling level, at 10-foot intervals along the length of the wall and at all interconnections of concealed vertical and horizontal spaces such as intersection of stud walls and soffits or dropped ceilings. A detail of typical fireblocking is included in this handout. Fireblocks may be constructed of 1-1/2 inch lumber, 3/4 inch plywood, OSB or particle board, 1/2 inch gypsum board or fiberglass insulation 16 inches minimum in height, securing fastened.

Fireblocking and Floated Wall Detail

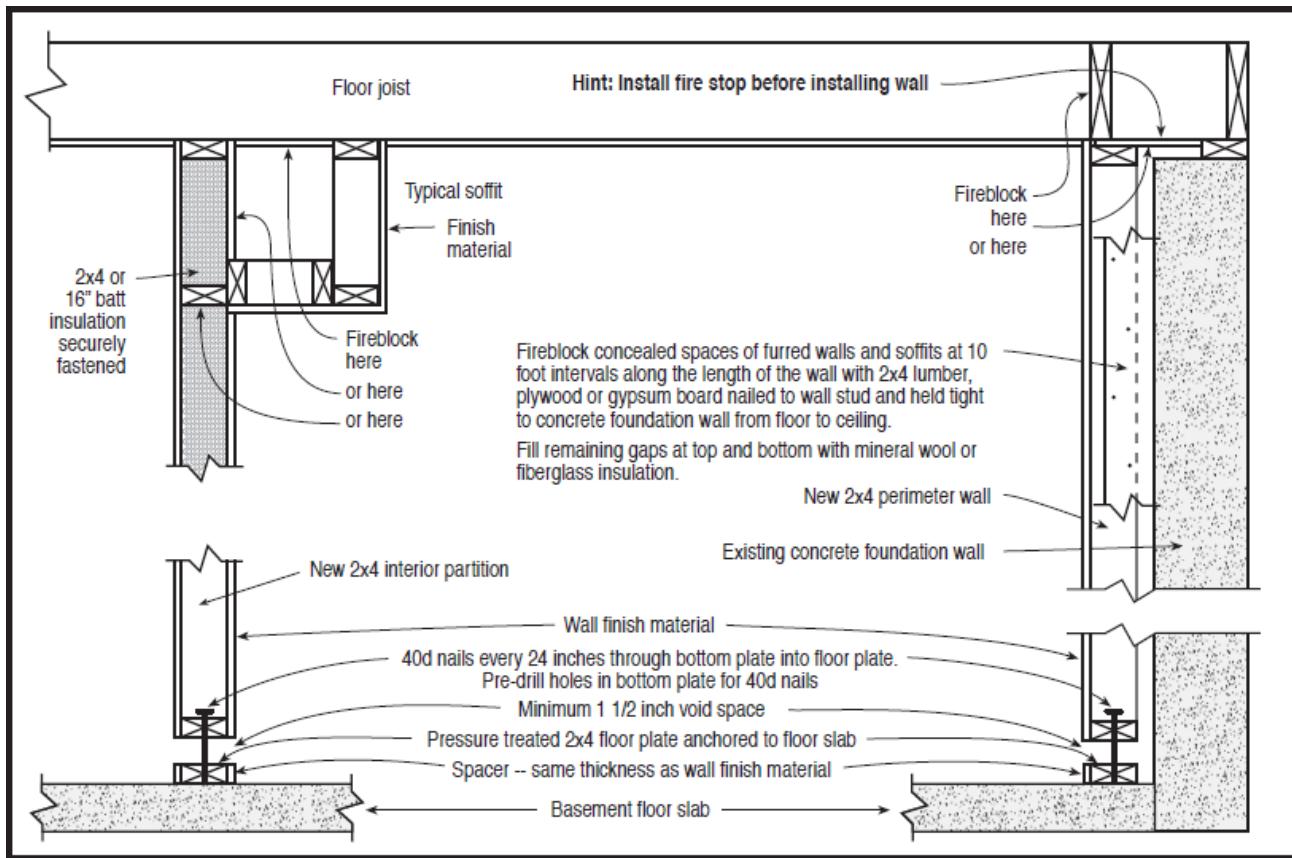

8. Insulation:

Minimum R-38 insulation required in attic spaces, minimum R-19 insulation is required in wood framed walls above grade, and minimum R-10 continuous insulation or R-13 cavity insulation is required in all perimeter walls below grade.

9. Space Under Stairs:

Enclosed accessible space under stairs shall have walls, under-stair surface and any soffits must be protected on the enclosed side by 1/2 inch (12.7 mm) gypsum board.

10. Bathrooms:

Toilets must be provided with a minimum of 21 inches in front of the toilet and 15 inches from the center of the toilet and any sidewall or other obstruction. Showers shall have a minimum inside dimension of 900 square inches, capable of encompassing a 30 inch circle and be finished 72 inches above the floor with non-absorbent materials. Shower door minimum clear opening width is 22 inches. See Exception 2, P2708.1.

10. (Cont.)

A ventilation fan is required in toilet rooms and bathrooms with un-openable windows. The fan must be vented to the exterior of the building and not to terminate within 3 feet of an opening.

11. Lighting & Ventilation:

All habitable rooms (rooms used for living, eating, sleeping, or cooking) must have natural light by means of exterior glazed openings with an area of not less than 8% of the floor area or artificial light as approved by the building official. Habitable rooms must also have natural ventilation with a minimum openable area of 4% of the floor area being ventilated.

Bathrooms, water closet compartments and other similar rooms shall be provided with aggregate glazing area in windows of not less than 3 square feet, one-half of which must be openable.

Exception: the glazed areas shall not be required where artificial light and a local exhaust system are provided. The minimum local exhaust rates shall be determined in accordance with Section M1507. Exhaust air from the space shall be exhausted directly to the outdoors.

12. Electrical Alterations:

If a conductor is extended more than 6 ft or the extension includes additional outlets or devices, then the entire circuit must be protected by Arc-Fault Circuit-Interrupters (210.12 NEC). Tamper resistant and Arc Fault protection is required. New wiring cannot be tied in to existing knob and tube, and a service upgrade may be required - contact the City of Loveland Power Department at 962-3581 with questions. *It is recommended that a licensed electrician be consulted prior to tapping in to or adding to existing circuits of any kind.*

13. Windows and Doors:

If the size of your windows or doors is changing, engineering may be required. Speak with a plans examiner prior to submittal to determine if this requirement pertains to your project.

***NOTE:** If an inspector questions the structural integrity of the space during inspection, the building department reserves the right to request a structural evaluation by an engineer.



City of Loveland

Fire / Flood Restoration

Building Division * 410 E 5th Street * Loveland, CO 80537
General Information (970) 962-2505
Inspection Line (970) 962-2100



Address: _____

Owner Name: _____ **Owner Phone:** _____

Owner Email: _____

Owner Address: _____
(Street) _____ (City) _____ (State) _____ (Zip) _____

Contractor Name: _____ **License Number:** _____ **Phone:** _____

Project Contact Name: _____ **Preferred Phone:** _____

Project Contact e-mail: _____

Roof damage? Y <input type="checkbox"/> N <input checked="" type="checkbox"/>	Has the electric service Y <input type="checkbox"/> N <input checked="" type="checkbox"/>	Electric Service Size: Amps: _____	Type of Heat: Gas <input type="checkbox"/> Electric <input checked="" type="checkbox"/>	Demo / Asbestos: Y <input type="checkbox"/> N <input checked="" type="checkbox"/>
Roof sq _____ Rafters # _____				

Describe Work/List Options:

Client Total Valuation \$

Electrical Subcontractor	Valuation \$
Mechanical Subcontractor	Valuation \$
Plumbing Subcontractor	Valuation \$

I certify this application is correct. I agree to perform the work described according to plans and specifications submitted and approved. I agree to comply with all city ordinances, state laws and building codes. Additionally, **I UNDERSTAND THAT I AM RESPONSIBLE FOR ANY FEES OR EXPENSES INCURRED FOR PLAN REVIEW, PERMITS, INSPECTIONS AND OTHER FEES ASSOCIATED WITH THIS APPLICATION. FAILURE TO PICK UP AND PAY FOR THIS PERMIT WITHIN 90 DAYS OF APPROVAL WILL RESULT IN THE APPLICATION BEING CLOSED AND THE PLAN CHECK FEES BEING ASSESSED. ALL FEES UNDER THIS APPLICATION THEN BECOME NULL AND VOID. This application does not authorize any work within the right-of-way or curb cuts, contact Public Works at 970-962-2516.**

Signature: _____ **Date:** _____

Received By: _____ Date: _____

Only enter the information as it pertains to the specific work performed under this application.